



EMPIRE WEST, INC.
9270 Graton Road
P.O. Box 511
Graton, California 95444
(707) 823-1190
www.empirewest.com
ed@empirewest.com

CEILUME CEILING TILES AND PANELS

CSI Section:

09 54 00 Specialty Ceilings

1.0 RECOGNITION

Empire West, Inc's Ceilume Ceiling Tiles and Panels recognized in this report have been evaluated for use as interior lay-in panels for ceilings. The interior finish classification, thermal stability, and physical properties of the Ceilume Ceiling Tiles and Panels comply with the intent of the provisions of the following codes and regulations:

- 2018, 2015, and 2012 International Building Code® (IBC)

2.0 LIMITATIONS

Use of the Ceilume Ceiling Tiles and Panels recognized in this report is subject to the following limitations:

2.1 The Ceilume Ceiling Tiles and Panels are manufactured, identified and installed in accordance with this report and the Empire West installation instructions. In the event of a conflict between this report and the installation instructions, the more restrictive assumes governance.

2.2 The Ceilume Ceiling Tiles and Panels are limited to use as a nonstructural component in non-fire-resistance-rated floor-ceiling or roof-ceiling assemblies.

2.3 Where translucent Ceilume Ceiling Tiles and Panels are used as light diffusers, installation shall comply with IBC Section 2606.7.

2.4 The 0.013-inch-thick (0.33 mm) and the 0.030-inch-thick (0.76 mm) tiles and panels are limited to use with quick response (release) or standard-response sprinklers rated at 135°F (57.2°C) or above when used with sprinkler systems.

2.5 Drop-out ceilings shall not be installed below extended coverage sprinklers unless specifically listed for that application.

2.6 Piping installed above drop-out ceilings shall not be considered concealed piping.

2.7 Tiles and panels shall remain unpainted or otherwise uncoated, unless approved otherwise.

2.8 Drop-out tiles and panels may be used in conjunction with dry-pipe sprinkler systems.

2.9 Quick-response (release) sprinklers rated at 135°F (57.2°C) or above shall be installed no less than 1 inch (25.4 mm), and no more than 5 feet (1524 mm) above the drop-out ceiling tiles and panels, when installed above the tiles and panels

2.10 Standard-response sprinklers rated at 135°F (57.2°C) or above shall be installed no less than 1 inch (25.4 mm), and no more than 5 feet (1524 mm) above the drop-out ceiling tiles and panels, when installed above tiles and panels.

2.11 Accessories for use with the ceiling tiles and panels are limited to the following installations:

- a. under wet or dry sprinkler systems
- b. with or without uplift prevention clips
- c. with or without AcoustoTherm® or Soniguard™ Insulation and/or EZ-ON Grid Covers

2.12 The ceiling tiles and panels shall be installed in accordance with FM Listing: OXOA7.AM (4651).

2.13 The Ceilume Ceiling Tiles and Panels recognized in this report are produced in Graton, California.

3.0 PRODUCT USE

3.1 General: Ceilume Ceiling Tiles and Panels are Class A interior finish lay-in panels for use in approved suspended ceiling framing systems in non-fire-resistance-rated floor-ceiling or roof-ceiling assemblies. The panels comply with Section 803 of the 2018, 2015, and 2012 IBC.

3.2 Installation: Ceilume Ceiling Tiles and Panels shall be installed only in a horizontal arrangement in suspended ceiling systems in accordance with the manufacturer's installation instructions. All installations shall be in approved suspended ceiling framing systems in non-fire-resistance-rated floor-ceiling or roof-ceiling assemblies.

The suspended ceiling framing system shall comply with and be installed in accordance with Sections 808.1.1 and 2506.2.1 of the 2018, 2015, 2012 IBC. Suspended ceilings located in Seismic Design Categories B, C, D, E, or F, shall comply with design and installation requirements set forth in Section 13.5.6 of ASCE 7-16 and ASCE 7-10, as applicable. The panels shall have a minimum of 1/4-inch (6.3 mm) edge support when installed using either a



standard 1 inch (25.4 mm) or a slim line 9/16 inch (14.3 mm) width T-bar grid framing as shown in Figure 2 of this report. The panels shall be installed in the framing members of suspended ceiling systems without the use of restraining clips that would impede or affect their downward movement. Uplift prevention clips are permitted but not required. Figure 1 of this report provides a detail of the clip.



Figure 1 – Uplift Prevention Clips Details

The space above the Ceilume Ceiling Tiles and Panels shall not be used as an air circulation plenum.

Installation of drop-out ceiling panels is prohibited in exits such as corridors, stairways, horizontal exits, pressurized enclosures and exit passageways as defined in Chapter 10 of the 2018, 2015 and 2012 IBC.

When automatic sprinklers are installed above, panels and tiles shall comply with requirements in IBC Section 2606.7 and may be installed as drop-out ceiling tiles and panels in light hazard and Group 1 ordinary hazard occupancies, as defined in NFPA 13.

The sprinklers shall be installed above the ceiling in accordance with NFPA 13, including separation from obstructions.

3.2.1 Installation With No Ceiling Sprinklers Present: Panels, in both nominal thicknesses of 0.013 inch (0.33 mm) and 0.03 inch (0.76 mm), may be installed throughout the ceiling.

3.2.2 Installation with No Ceiling Sprinklers Present – Refacing Mineral Fiber Tiles: Panels in nominal thickness of 0.03 inch (0.76 mm) may be installed beneath mineral fiber tiles throughout the ceiling.

3.2.3 Installation with Ceiling Sprinklers Penetrating Tiles – Oversized Hole: Tiles and Panels, in both nominal thicknesses of 0.013 inch (0.33 mm) and 0.03 inch (0.76 mm), may be installed by themselves. Sprinklers shall be

located a maximum of 3 inches (76 mm) below the ceiling grid. Standard trim rings/escutcheons may be used at sprinkler penetrations. When trim rings/escutcheons are used corresponding openings in panel tiles shall be a minimum of ¼ inch (6.3 mm) larger than the outer diameter of the trim ring/escutcheon to enable tiles to fall from the ceiling grid without becoming entangled with the sprinkler or interfering with its operation. When escutcheons are not used the opening in panel tiles shall be a minimum of ¼ inch (6.3 mm) greater than the sprinkler head.

3.2.4 Installation with Ceiling Sprinklers Penetrating Tiles – Refacing Mineral Fiber - Penetrations Only: At sprinkler penetrations panels in nominal thickness of 0.03 inch (0.76 mm) shall be installed beneath mineral fiber tiles. Sprinklers shall be located a maximum of 3 inches (76 mm) below the ceiling grid. Standard trim rings/escutcheons may be used at penetrations. When trim ring/escutcheons are used corresponding opening in panel tiles shall be ¼ inch (6.3 mm) smaller than the outer diameter of the trim ring/escutcheon. When trim rings/escutcheons are not used the opening in panel tiles shall be a minimum of ¼ inch (6.3 mm) larger in diameter than the sprinkler head.

3.2.5 Installation with Ceiling Sprinklers Penetrating Tiles – Refacing Mineral Fiber – Full Ceiling: Ceilume Ceiling Tiles and Panels in 0.03-inch (0.76 mm) thickness may be installed beneath mineral fiber tiles throughout the ceiling and shall be installed beneath mineral fiber at sprinkler penetrations. Standard trim rings/escutcheons shall be used at sprinkler penetrations, in accordance with Section 4.2 of this report.

3.2.6 Installation with Ceiling Sprinklers Above Ceilume Ceiling Tiles and Panels – Concealed Sprinklers – Full Ceiling: Panels, both 0.013 (0.33 mm) and 0.03 (0.76 mm) thickness, may be installed by themselves throughout the ceiling below sprinkler heads, pursuant to Sections 2.3 through 2.13 of this report.

4.0 PRODUCT DESCRIPTION

4.1 Product information: Ceilume Ceiling Tiles and Panels are thermoformed polyvinyl chloride (PVC) panels. The panels are nominally 24 inches by 24 inches [actually 23.75 inches long by 23.75 inches wide (603.3 mm by 603.3 mm)] and nominally 24 inches by 48 inches (actually 23.75 inches long by 47.75 inches wide (603.3 mm by 1212.9 mm), and are available in two thicknesses and multiple colors.

4.1.1 Premier Featherlight: Nominal thickness of 0.013 inch (0.33 mm) and weight of 167 grams (5.89 ounces) for a nominally 24-inch-by-24-inch panel, and a weight of 334 grams (11.78 ounces) for a nominal 24-inch-by-48-inch panel.

4.1.2 Premier Signature: Nominal thickness of 0.03 inch (0.76 mm) and weight of 381 grams (13.43 ounces) for a nominal 24-inch-by-24-inch panel, and a weight of 762



grams (26.86 ounces) for a nominally 24-inch-by-48-inch panel.

4.1.3 Better Than Tin/Faux Wood; Feather-Light: Nominal thickness of 0.013 inch (0.33 mm) and weight of 167 grams (5.89 ounces) for a nominal 24-inch-by-24-inch panel, and a weight of 334 grams (11.78 ounces) for a nominal 24-inch-by-48-inch panel.


4.1.4 Better Than Tin/Faux Wood; Signature: Nominal thickness of 0.03 inch (0.76 mm) and weight of 381 grams (13.43 ounces) for a nominal 24-inch-by-24-inch panel, and a weight of 762 grams (26.86 ounces) for a nominally 24-inch-by-48-inch panel.

4.2 Interior Finish Classification

Ceilume Ceiling Tiles and Panels, which have a minimum nominal thickness of 0.013 inch (0.25 mm) and a maximum nominal thickness of 0.03 inch (0.76 mm), have a Class A interior finish classification in accordance with Section 803.1.1 of the IBC, with a flame-spread index of not more than 25, and a smoke-developed index of not more than 450.

5.0 IDENTIFICATION

A label shall be affixed on at least one of the following: product, packaging, installation instructions or descriptive literature. The label shall include the company name or trademark, model number, and the IAPMO Uniform ES Mark of Conformity, the name of the inspection agency (when applicable) and the Evaluation Report Number (ER-310) to identify the products recognized in this report. A die-stamp label may also substitute for the label. Either Mark of Conformity may be used as shown below:

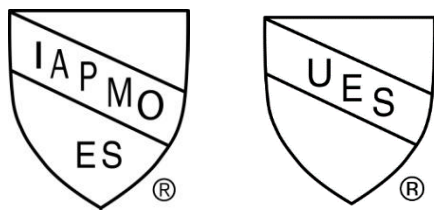

or
IAPMO ER-310

6.0 SUBSTANTIATING DATA

Data and Test Reports submitted from this report are from laboratories recognized in compliance with ISO/IEC 17025 and the following:

6.1 Reports of Optical Density of Smoke in accordance with ASTM E662.

6.2 Reports of Ignition Properties of Plastics in accordance with ASTM D1929.

6.3 Reports of Surface Burning Characteristics in accordance with ASTM E84.

6.4 Reports of Room Fire Testing in accordance with UBC Standard No. 26-3.

6.5 Data in accordance with NFPA 13-10, -13 and -16.

6.6 Test reports are from laboratories in compliance with ISO/IEC 17025.

7.0 STATEMENT OF RECOGNITION

This evaluation report describes the results of research carried out by IAPMO Uniform Evaluation Service on Empire West Inc.'s Ceilume Ceiling Tiles and Panels to assess conformance to the codes shown in Section 1.0 of this report and serves as documentation of the product certification. Products are manufactured at the location noted in Section 2.13 of this report under a quality control program with periodic inspection under the supervision of IAPMO UES.

Brian Gerber, P.E., S.E.
Vice President, Technical Operations
Uniform Evaluation Service

Richard Beck, PE, CBO, MCP
Vice President, Uniform Evaluation Service

GP Russ Chaney
CEO, The IAPMO Group

For additional information about this evaluation report please visit www.uniform-es.org or email us at info@uniform-es.org

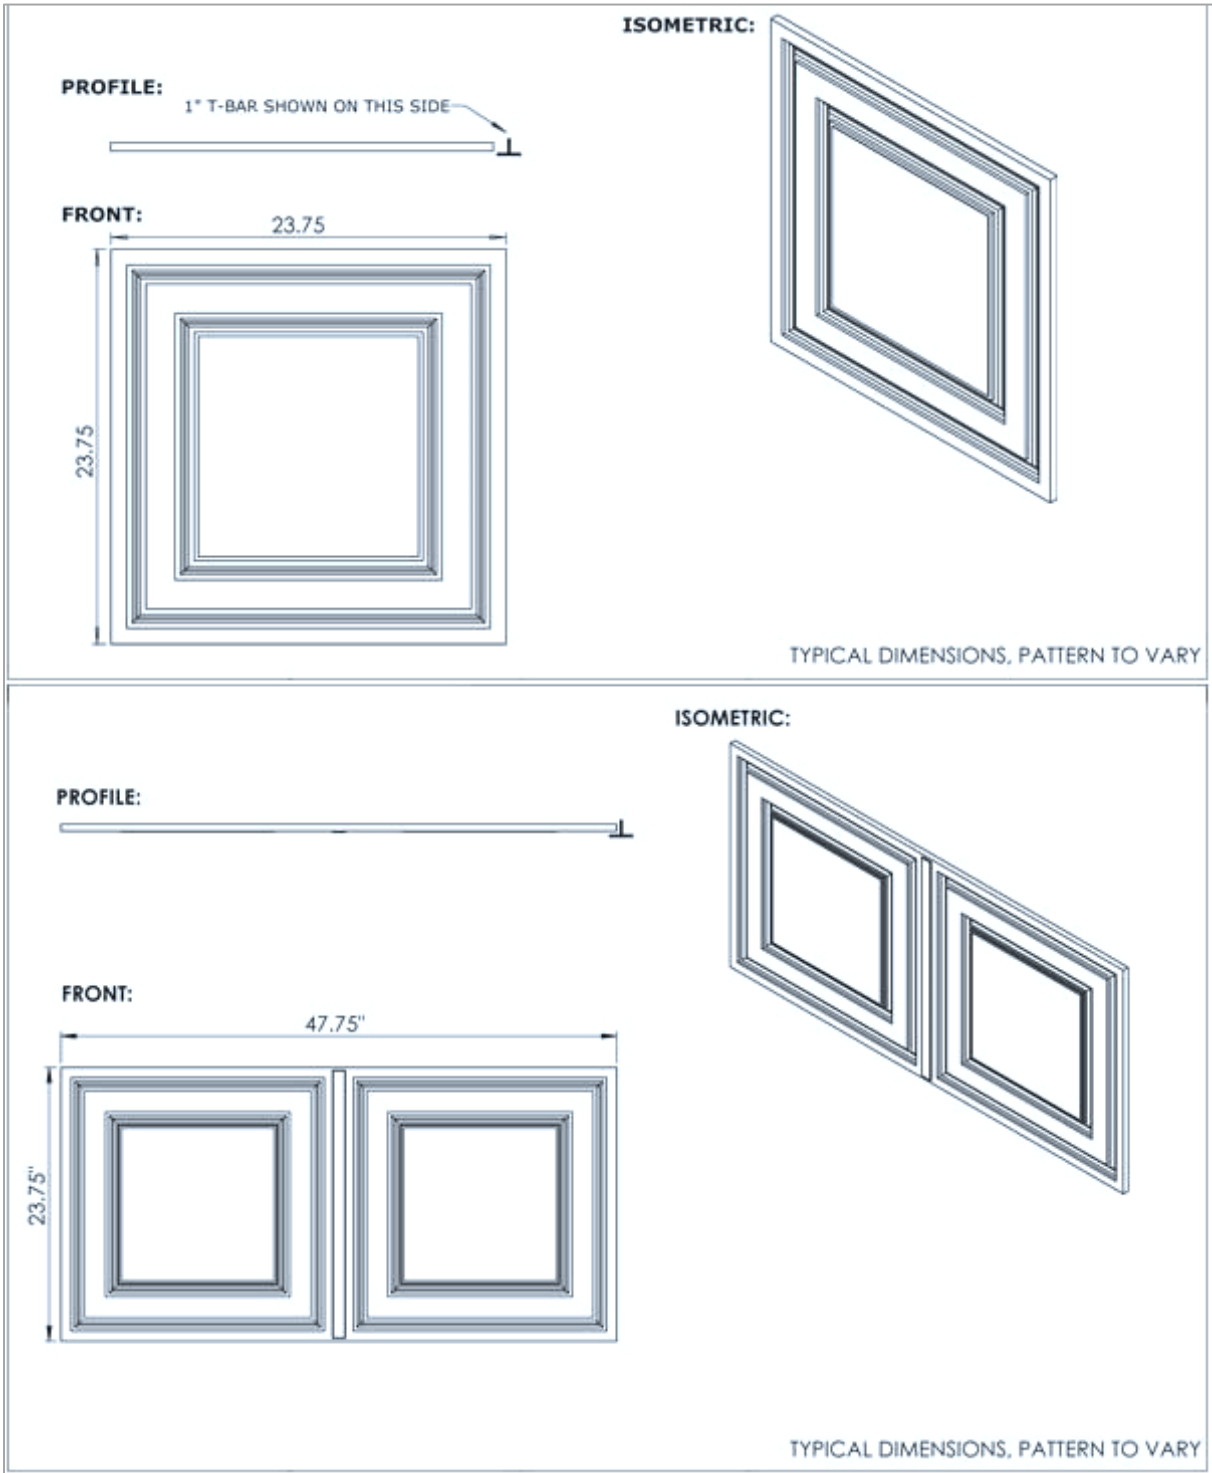


Figure 2 – Ceilume Ceiling Tiles and Panels Details